


LEGEND

-  ELECTRICAL SERVICES SWITCHBOARD.
-  SWITCHBOARD / CONTROL PANEL NOT PROVIDED AS PART OF THE ELECTRICAL SUBCONTRACT.
-  SINGLE POWER OUTLET.
-  DOUBLE POWER OUTLET.
-  SPECIAL PURPOSE OUTLET.
-  ELECTRICAL CONNECTION AS NOTED.
-  SIGNAGE CONNECTION.
-  SINGLE PHASE ISOLATOR.
-  THREE PHASE ISOLATOR.
-  CEILING FAN CONTROLLER.
-  LIGHTING CONTROL SWITCHPANEL, TYPE x.
-  ONE-WAY LIGHT SWITCH.
-  MANUAL DALI POT DIMMER / SWITCH.
-  CIRCUIT LINE.
-  SWITCH LINE.
-  DB-x - Py POWER CIRCUIT DESIGNATION. DENOTES DB AND CIRCUIT.
-  LIGHTING CONTROL CHANNEL REFERENCE.
-  ELECTRICAL EQUIPMENT AS NOTED.
-  REFER TO DETAIL NOTED FOR THE AREA SHOWN HATCHED. ADDITIONAL OUTLETS & FITTINGS MAY BE SHOWN ON DETAIL.
-  Sx: LED JOINERY / CEILING STRIP LIGHT, TYPE AS NOTED.
-  E1: GENERAL CEILING RECESSED LED EMERGENCY LIGHT, WHITE.
-  E2: GENERAL CEILING RECESSED LED EMERGENCY LIGHT, BLACK.
-  E3: SURFACE MOUNTED LED EMERGENCY LIGHT, BLACK.
-  EX: EMERGENCY LED EXIT LIGHT, WHITE.
-  EX BK: EMERGENCY LED EXIT LIGHT, BLACK.
-  PD01: DECORATIVE SUSPENDED PENDANT.
-  PD02: DECORATIVE SUSPENDED PENDANT.
-  PD03: DECORATIVE SUSPENDED PENDANT.
-  TL01: SURFACE TRACK LIGHTS, BLACK.
-  WL01: DECORATIVE WALL LIGHT.
-  WL02: DECORATIVE WALL LIGHT.
-  WL03: DECORATIVE WALL LIGHT.
-  WL04: DECORATIVE WALL LIGHT.
-  WL05: DECORATIVE WALL LIGHT.
-  WL06: DECORATIVE WALL LIGHT.
-  GL01: GARDEN STAKE LIGHT.
-  UL01: EXISTING INGROUND UPLIGHT TO BE REPLACED.
-  UL02: EXISTING INGROUND UPLIGHT TO BE REPLACED.
-  SL01: 1200 LONG SURFACE BATTEN.
-  SL02: SURFACE CAN DOWNLIGHT, WHITE.


LEGEND

-  RD01: RECESSED DOWNLIGHT, BLACK.
-  RD02: RECESSED DOWNLIGHT, WHITE.
-  RD03: RECESSED DOWNLIGHT, WHITE.
-  RD04: RECESSED ADJUSTABLE DOWNLIGHT, WHITE.
-  RD05: RECESSED DOWNLIGHT, WHITE.
-  RD06: RECESSED DOWNLIGHT, WHITE.
-  RD07: RECESSED DOWNLIGHT, WHITE.
-  RD08: RECESSED DOWNLIGHT, BLACK.
-  RT01: 300 x 1200 FLAT PANEL LIGHT.
-  HL01: HEAT LAMP TYPE 1.
-  HL02: HEAT LAMP TYPE 2.
-  F01: NEW 1400 DIA CEILING FAN.
-  F02: NEW 900 DIA CEILING FAN.
-  FE: EXISTING CEILING FAN.

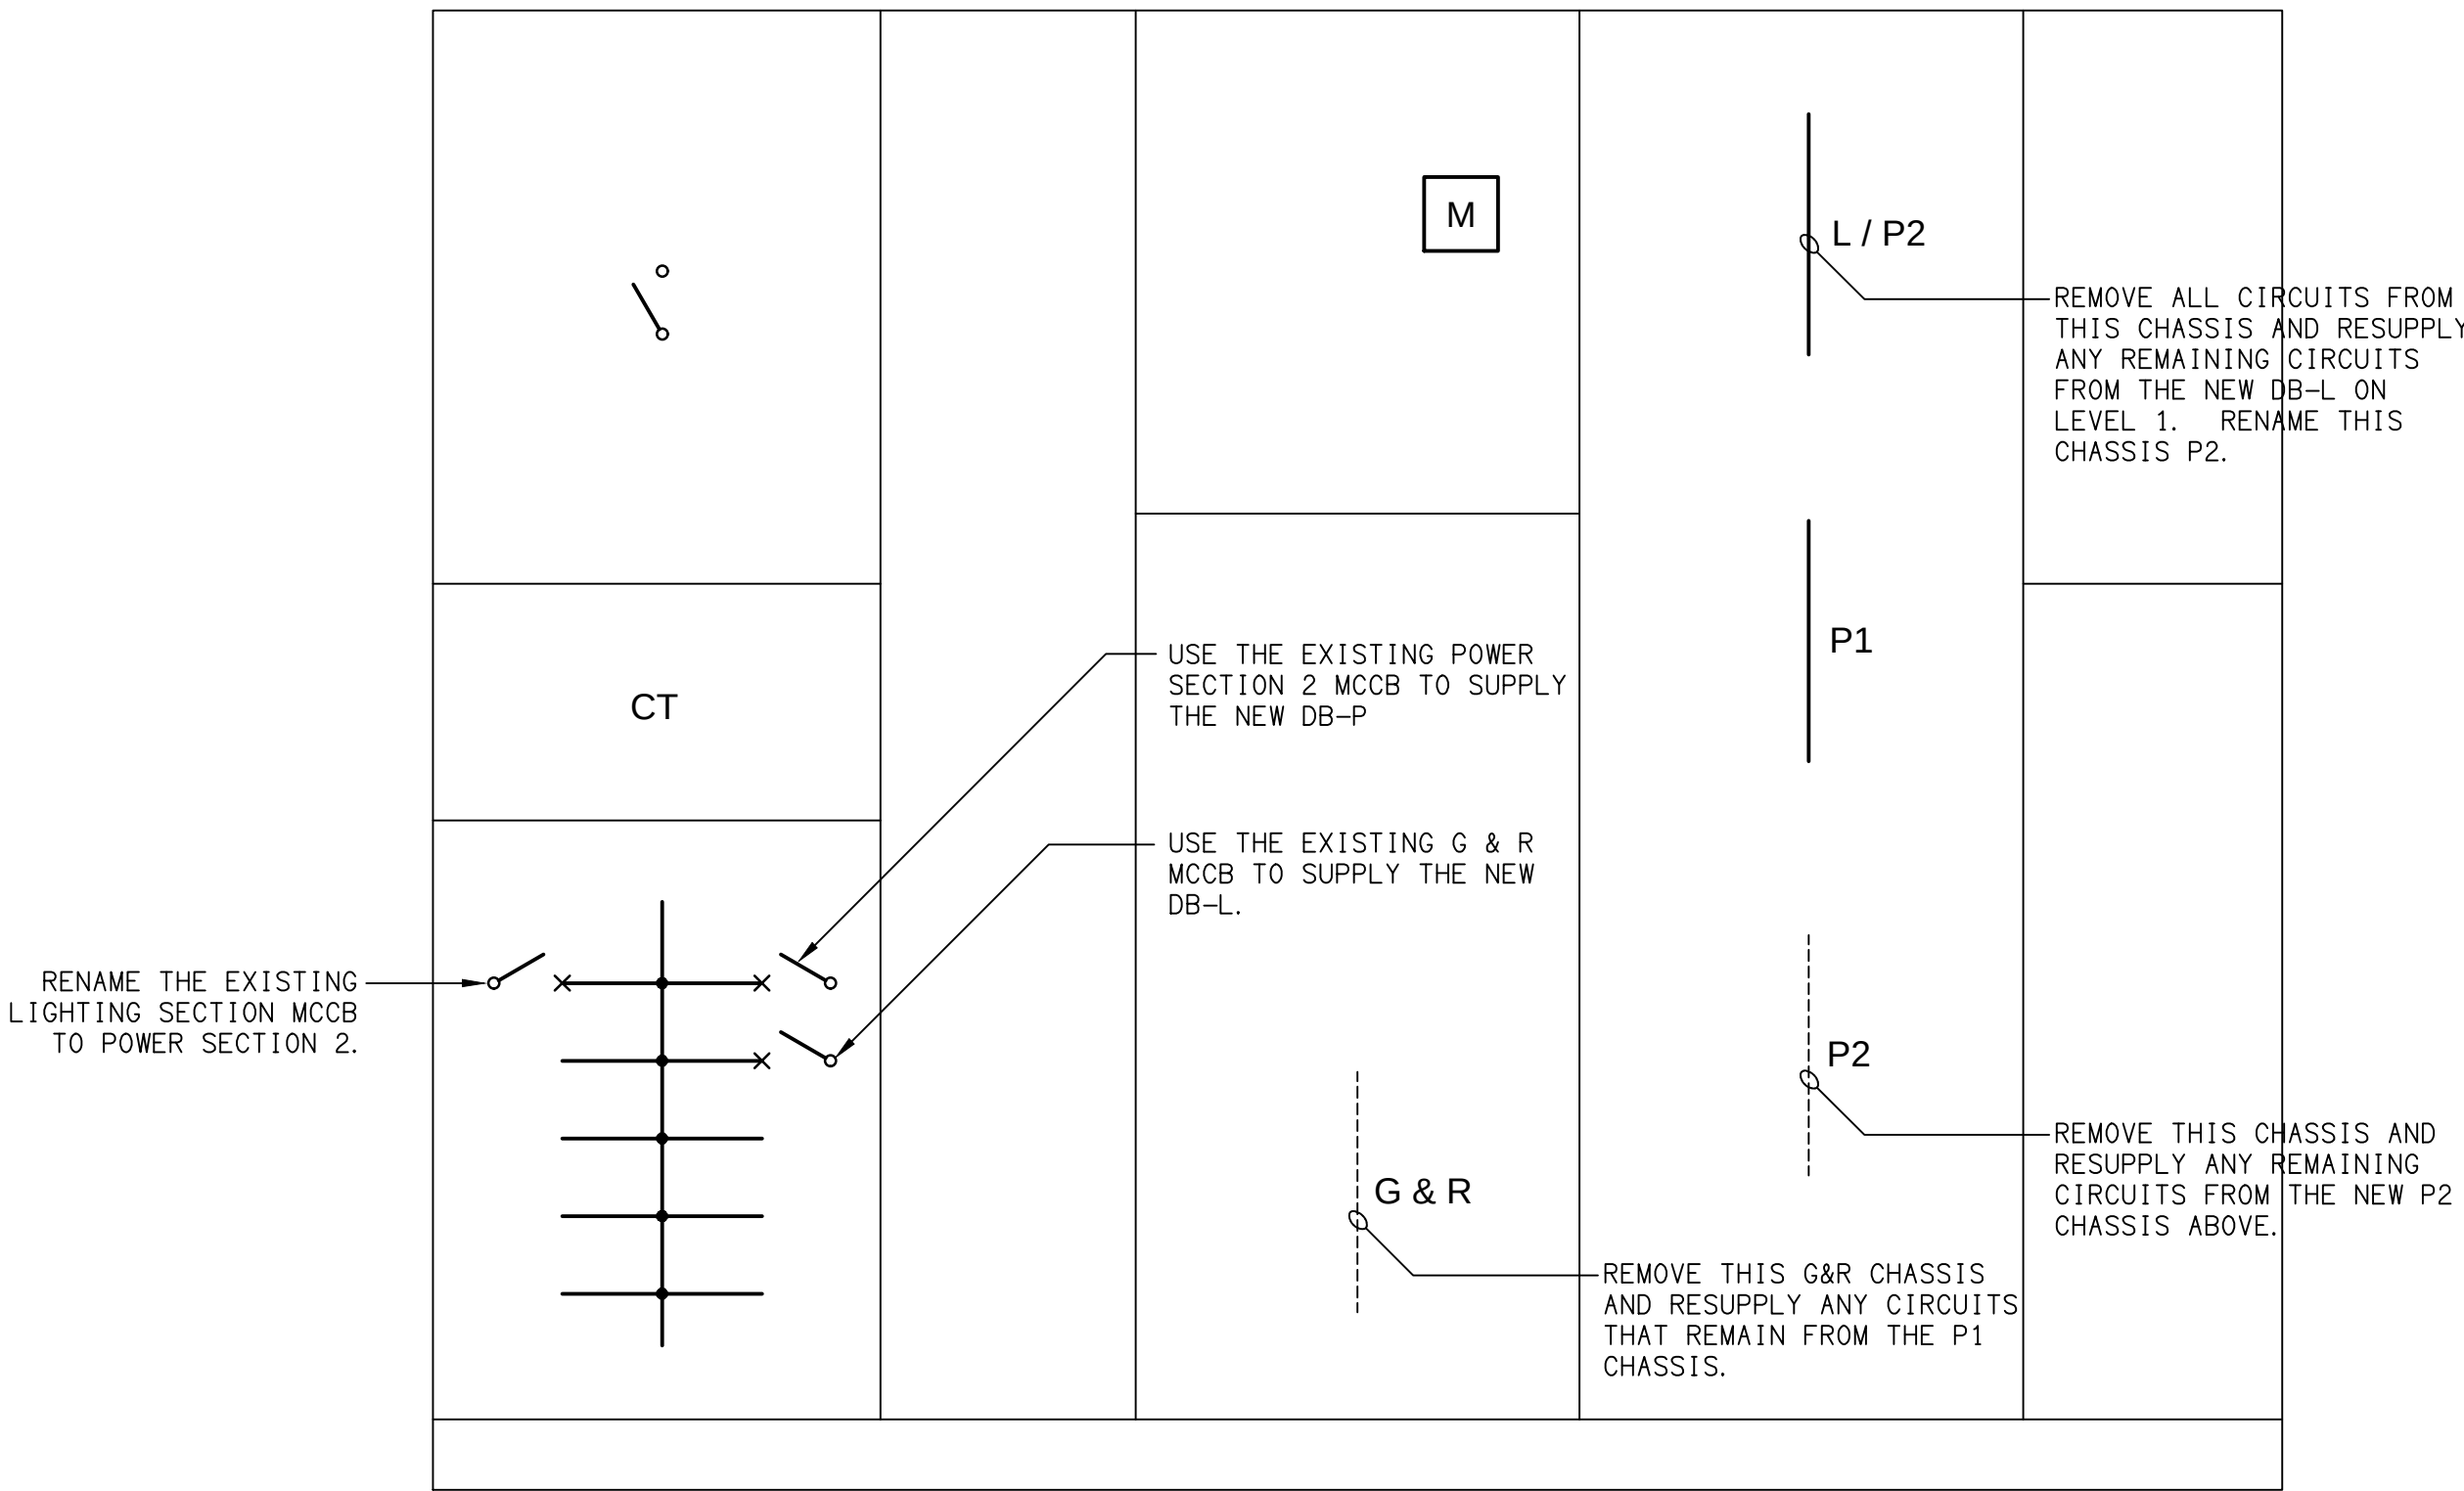

EQUIPMENT:

- TEST – TEST PUSH BUTTON MOUNTED ON THE DISTRIBUTION BOARD ESCUTCHEON.
- RESET – RESET PUSH BUTTON MOUNTED ON THE DISTRIBUTION BOARD ESCUTCHEON.
- LAMP – AMBER TEST INDICATING LAMP MOUNTED ON THE DISTRIBUTION BOARD ESCUTCHEON.
- Ta – ADJUSTABLE 0-3 HOUR TIMED RELAY.
- Tb – 15 MINUTE RUN-ON TIMER TO OPERATE UPON THE RETURN OF MAINS POWER.
- Cx – CONTACTOR x.
- CRx – CONTROL RELAY x.
- Rx – RELAY x.

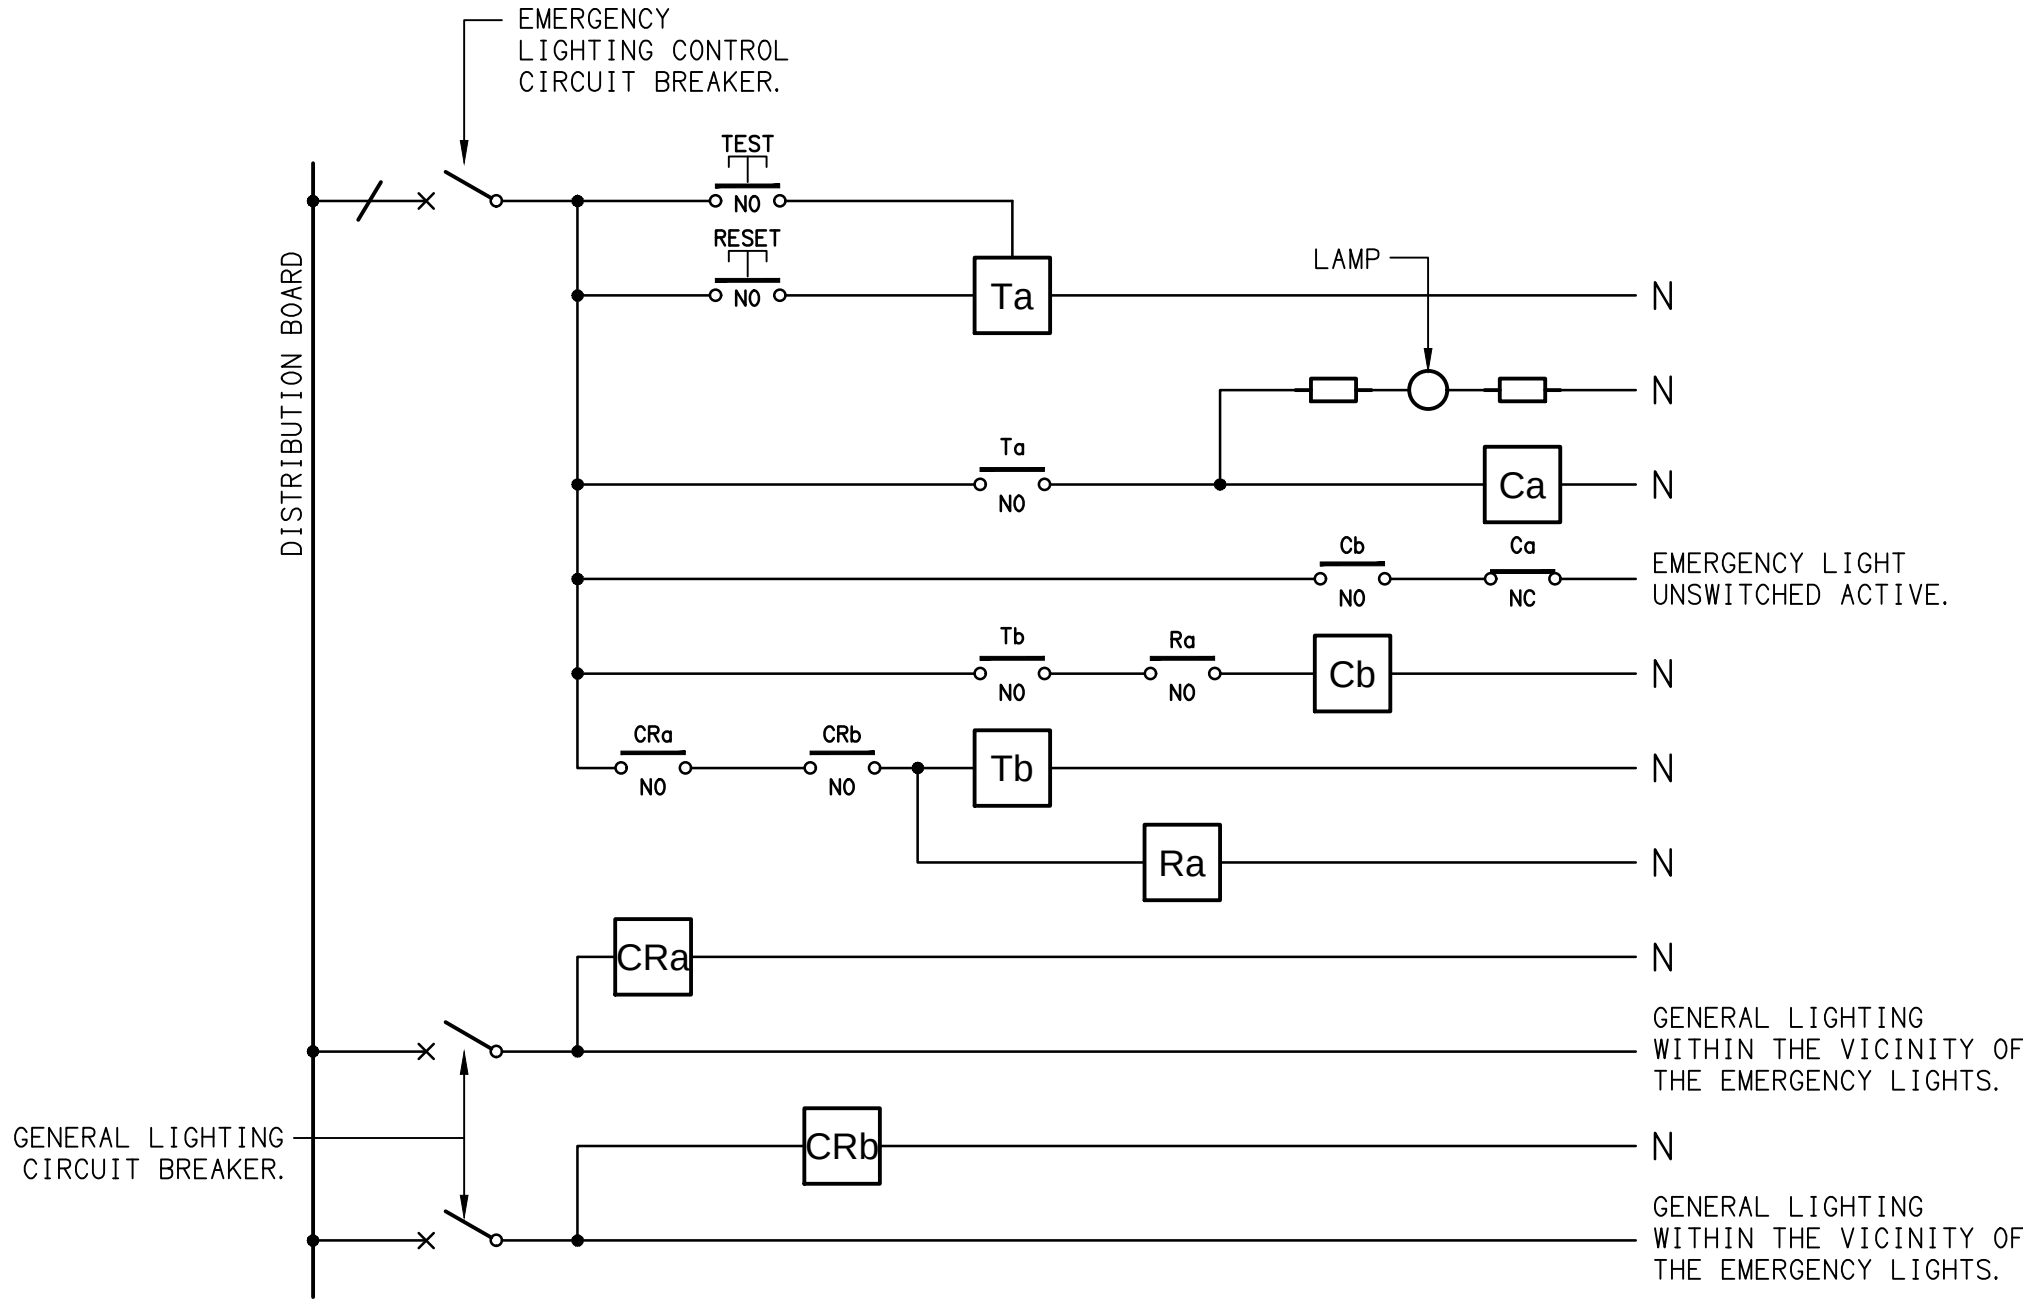

NOTES

1. THE EMERGENCY LIGHT UNSWITCHED ACTIVE / GENERAL LIGHTING SWITCHED ACTIVE CIRCUIT ARRANGEMENT AND CONTROL IS TYPICAL FOR ALL CIRCUITS SUPPLYING EMERGENCY LIGHTS.
2. PROVIDE ADDITIONAL CONTROL RELAYS (CRx) CONFIGURED AS PER CRa AND CRb FOR ALL ADDITIONAL LIGHTING CIRCUITS THAT SUPPLY LIGHTS IN THE VICINITY OF THE EMERGENCY LIGHTS.

