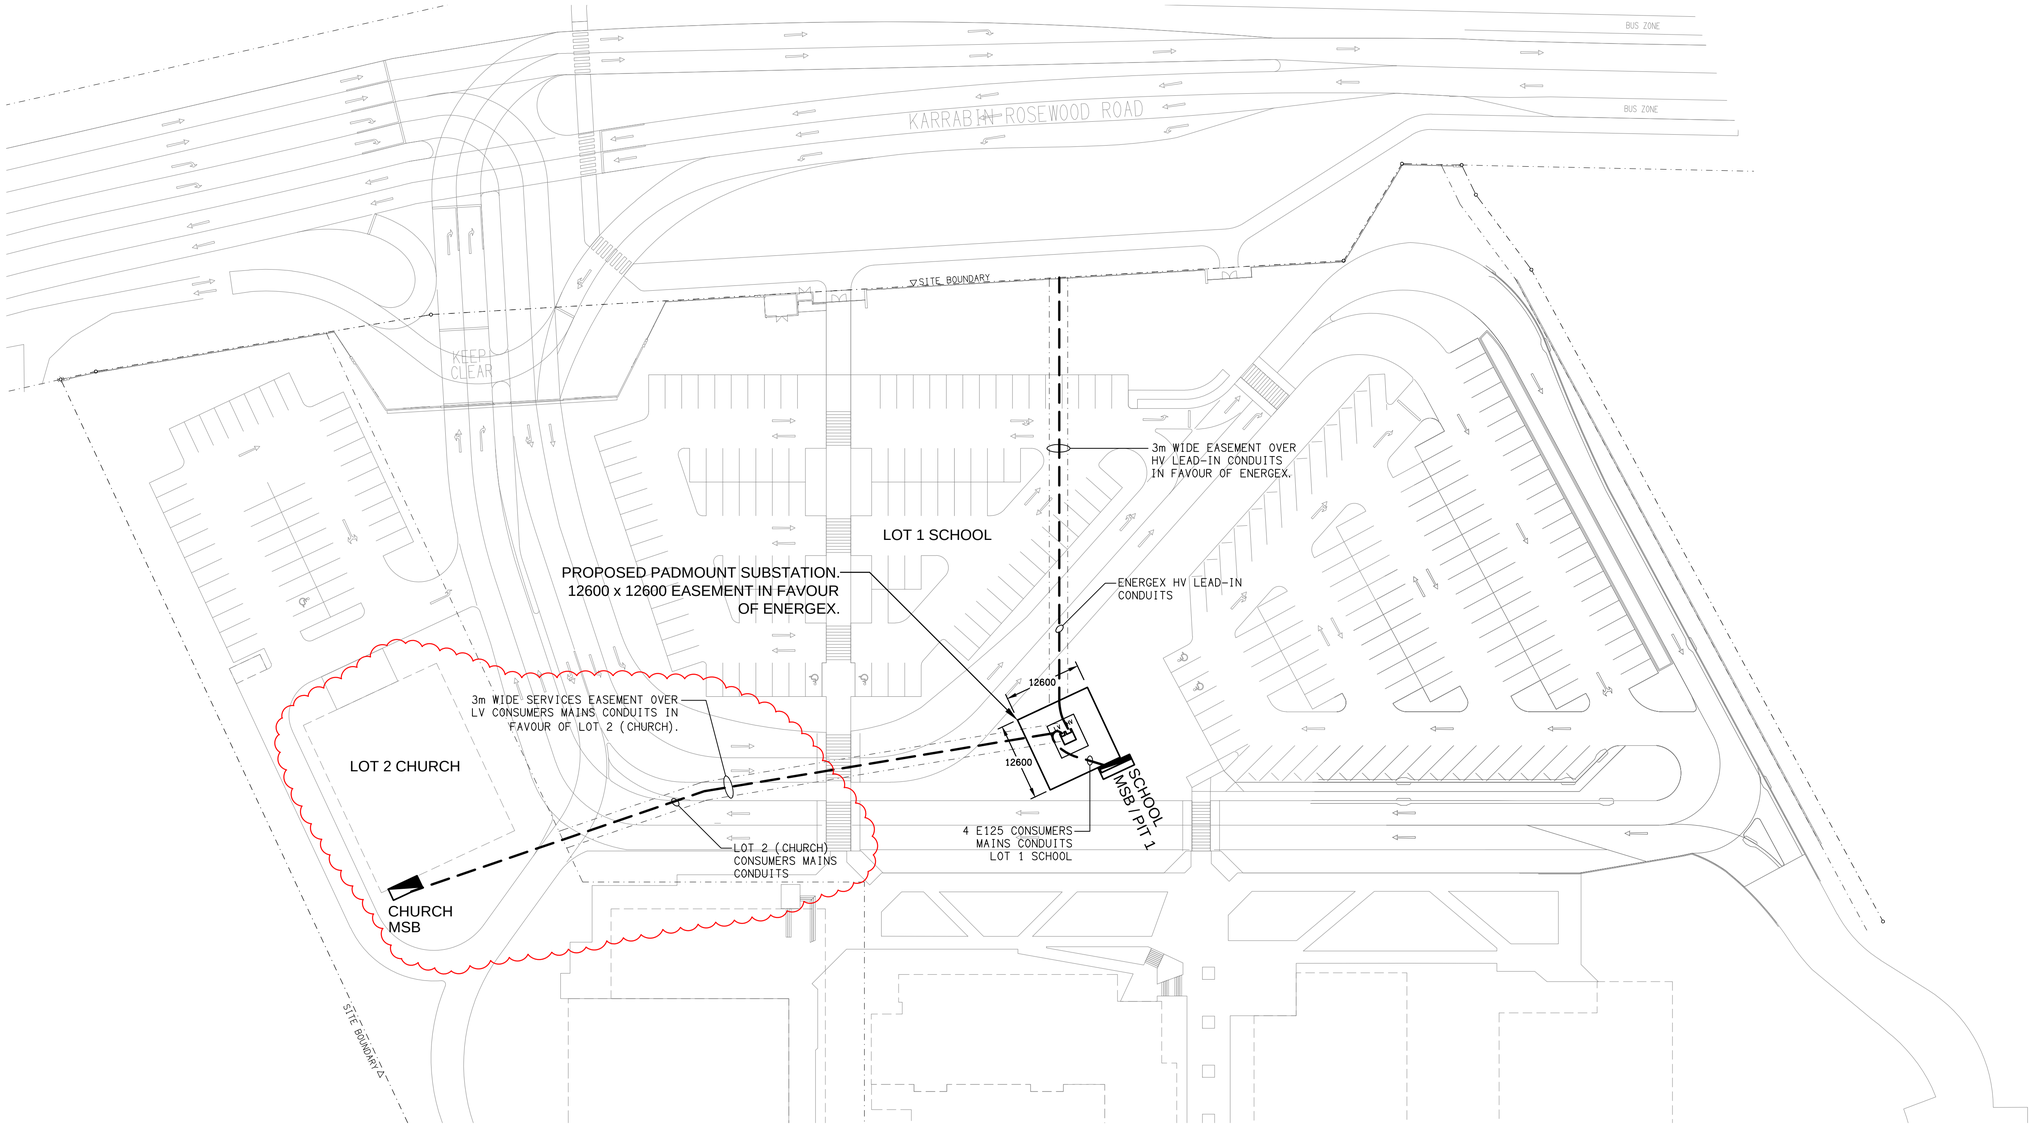


ENERGEX ACCEPTANCE

NAME

OFFICE

SIGNED

DATE / /

ENERGEX takes no responsibility for the accuracy of the information provided on this drawing

BEFORE YOU DIG www.byda.com.au

REV:	DESCRIPTION:	DATE:
B	CONSTRUCTION	01/10/2026

ELECTRICAL DESIGN GROUP BRISBANE PTY LTD
ACN 092 710 793

TRADING AS:
ELECTRICAL DESIGN GROUP

THE COPYRIGHT OF THIS DRAWING REMAINS THE PROPERTY OF THE ELECTRICAL DESIGN GROUP.

USE FIGURED DIMENSIONS IN PREFERENCE TO SCALE.

ALL DIMENSIONS TO BE VERIFIED ONSITE.

CULVERT INSPECTION REQUIRED BEFORE TRANSFORMER IS DELIVERED
- 48 HOURS PRIOR NOTICE NEEDED.
CONTACT _____ on _____

TRANSFORMER WILL NOT BE ENERGISED UNTIL ALL REQUIREMENTS ARE MET.

ELECTRICAL DESIGN GROUP
ELECTRICAL BUILDING SERVICES CONSULTANTS
BRISBANE GOLD COAST
P.O.Box 15, Sherwood Qld 4075
Phone: 0418 893 338
Email: brisbane@edg.net.au
Web: www.edg.net.au

PROJECT:
KINGS CHRISTIAN COLLEGE
WALLOON STAGE 1 PROJECT 2 WAL01

636 KARRABIN ROSEWOOD ROAD, WALLOON

DRAWING:
ELECTRICAL SERVICES
ENERGEX PADMOUNT SUBSTATION SITE PLAN

SCALE: 1:500 AT A1

PROJECT NO:	DRAWING NO:	REVISION:
C3808a	EN02	B